


Teal outline indicates compounds that are confirmed at TriCore Reference Laboratories with test code MXOPIT.

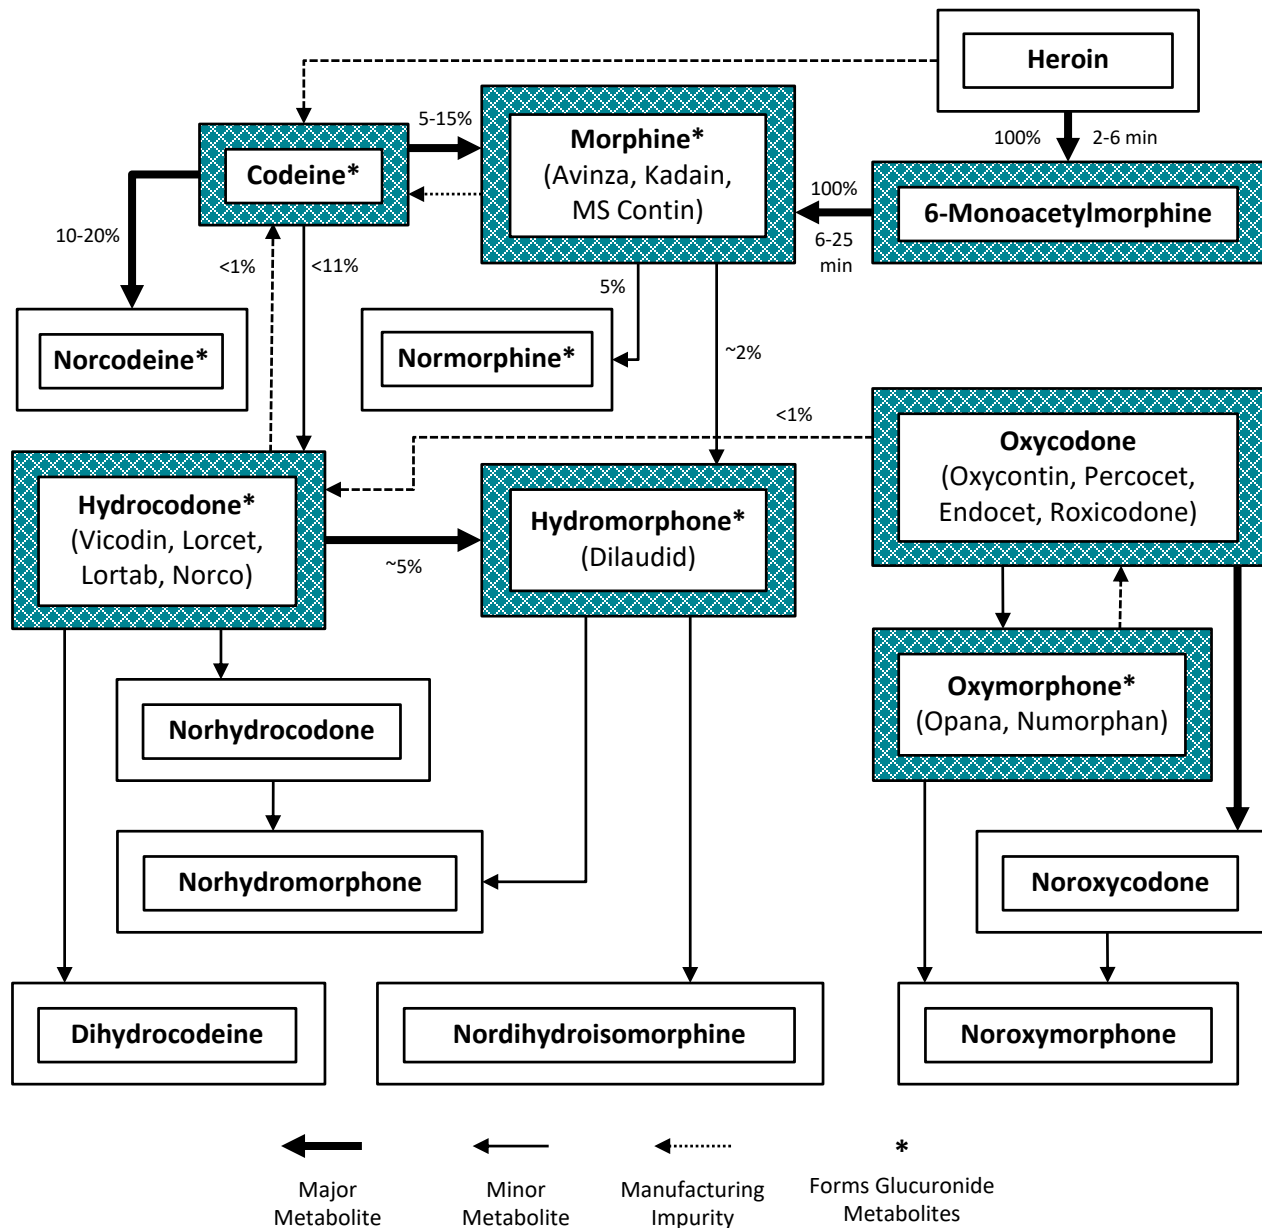

Screen cut-off: 300 ng/mL

Confirmation cut-off: 50 ng/mL for all compounds, except 6-MAM at 5 ng/mL

### Notes

- The UOPIT test code screen is not sensitive to oxycodone and oxymorphone; instead, use the UOXYC test code.
- Therapeutic doses of ofloxacin (Floxin) or levofloxacin (Levaquin) may cause a false positive screen result.
- Ingestion of poppy seed products can cause a positive result.